


THIS IS A TWO-SIDED DOCUMENT

 <p>NEW YORK STATE OF OPPORTUNITY.</p> <p>Adirondack Park Agency</p> <p>PO Box 99 · 1133 NYS Route 86 Ray Brook, NY 12977 Tel: (518) 891-4050 www.apa.ny.gov</p>	<p>APA General Permit/Order 2019G-1</p>	<p>Permit #: 2023-0048</p>
	<p>Certification for the Replacement of Certain Utility Poles</p>	

This certification under General Permit 2019G-1 is granted to Niagara Mohawk Power Corporation d/b/a National Grid, authorizing the replacement of one utility pole as described herein in the Town of Franklin, Franklin County.

All terms and conditions of this certification shall apply to the applicant and any individual, contractor, municipality, or other entity undertaking the authorized work on the project site.

This certification does not grant any right to trespass upon the lands or interfere with the riparian rights of others, nor does it authorize the impairment of any easement, right, title, or interest in real or personal property.

Nothing contained in this certification shall be construed to satisfy any legal obligations of the applicant to comply with all applicable laws and regulations or to obtain any governmental approval or permit from any entity other than the Agency, whether federal, state, regional, or local.

PROJECT DESCRIPTION AS PROPOSED

The project as conditionally approved herein involves the replacement of an existing utility pole measuring 38.5 feet in height with a new pole measuring 43 feet in height located within the existing utility right-of-way.

The project is shown on the following maps, plans, and reports:

- A plan sheet titled "Easement #: 24-21-30449948", prepared by National Grid, and dated October 25, 2021 (Easement Map); and
- A plan sheet titled "National Grid USA 24-21-30449948", prepared by National Grid, and dated November 2, 2022 (Site Plan).

A reduced-scale copy of the Site Plan for the project is attached to this certificate for easy reference.

CONDITIONS

1. The height and location of the replacement utility pole and any associated vegetative cutting and maintenance shall comply with all applicable utility laws, regulations, safety requirements, and company specifications.

2. For projects involving wetlands:
 - a. Whenever practicable, access through wetlands shall occur on frozen ground and with the use of wide-tracked vehicles.
 - b. All activities shall occur in compliance with the "Best Management Practice for Preventing the Transportation of Invasive Plant Species," published by Environmental Energy Alliance of New York, 4/26/2012.
 - c. No temporary access structure, including bog mats and work pads, shall be located within a wetland for more than 30 days.
 - d. Existing poles to be replaced shall be removed completely from the wetland, including the portion of the pole that was below grade.
 - e. If any hole left after removal of a pole or created for a replacement pole is to be backfilled with gravel or other ballast, the top six inches shall be covered with organic soil and the final elevation shall be the same as the surrounding wetland surface.
 - f. The total area of wetland disturbance shall be limited to that necessary for replacement of the utility poles.
3. When brought from off-site, all vehicles, construction equipment, and hand excavation tools to be used on the project site shall be clean and free of soil, mud, or other similar material. If washed on the project site, equipment shall be washed in one location to prevent the distribution of propagules among different wash sites. All vehicles, construction equipment, and hand excavation tools used in areas that may contain existing invasive species shall be thoroughly cleaned prior to moving to other areas.
4. The Agency may conduct on-site investigations, examinations, and evaluations as it deems necessary to ensure compliance with the terms and conditions of this certification.

CERTIFICATION issued this 21st day
of March, 2023.

ADIRONDACK PARK AGENCY

BY: _____

John M. Burth
Environmental Program Specialist 3 (EPS3)

STATE OF NEW YORK
COUNTY OF ESSEX

On the 21st day of March in the year 2023, before me, the undersigned, a Notary Public in and for said State, personally appeared John M. Burth, personally known to me or proved to me on the basis of satisfactory evidence to be the individual whose name is subscribed to the within instrument and acknowledged to me that they executed the same in their capacity, and that by their signature on the instrument, the individual, or the person upon behalf of which the individual acted, executed the instrument.

Stephanie L. Petith
Notary Public

Stephanie L. Petith
Notary Public, State of New York
Reg. No 01PE6279890
Qualified in Franklin County
Commission Expires April 15, 2025

NATIONAL GRID USA
24-21-30449948

DATE: 11/09/2022
PROJECT NO: 2023-0048
PROJECT NAME: NEW RESIDENTIAL SERVICE

PROJECT LOCATION: 9931 ST RT 3 VERMONTVILLE NY
PROJECT OWNER: ERIC CARTER

SCALE: 1" = 40'


DATE: 11/09/2022

PROJECT NO: 2023-0048

PROJECT NAME: NEW RESIDENTIAL SERVICE

PROJECT LOCATION: 9931 ST RT 3 VERMONTVILLE NY

PROJECT OWNER: ERIC CARTER

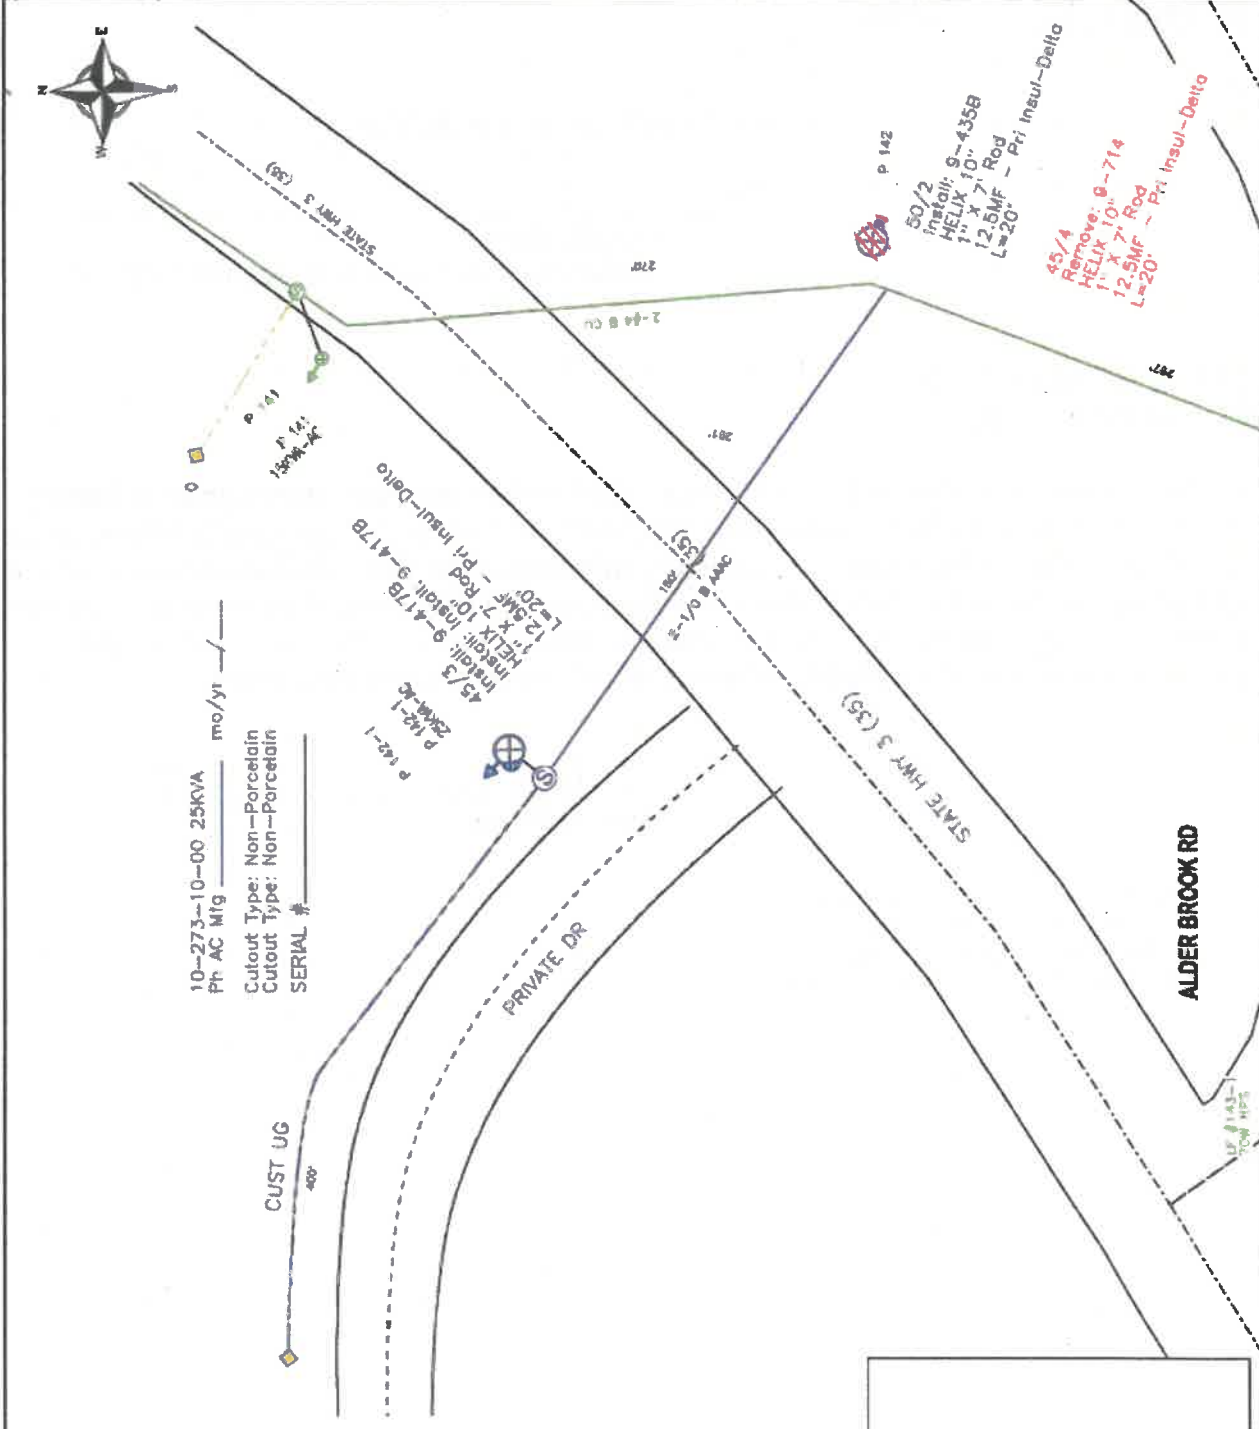

ERIC CARTER
9931 ST RT 3 VERMONTVILLE NY
PHONE: 518-643-7112

NEW RESIDENTIAL SERVICE
200 AMP- 120V/240V

4.8 KV FEEDER 84762
SS TAP ON CUST UG
REPL P142 WITH 50/2
INSTALL 45/3 WITH ANCHOR AND GUY
INSTALL RISER AND 25 KVA XFMR
INSTALL 150' OH PRIMARY

STATE HWY PERMIT NEEDED
APA PERMIT NEEDED FOR 50' POLE

Call 811
Before You Dig

	Anchor - existing
	Anchor - install
	Anchor - replace
	OH Transformer (Tpt) - existing
	OH Transformer (Tpt) - install
	Pole (Joint) - existing
	Pole (Joint) - install
	Pole (Joint) - replace
	Primary OH (1ph) - existing
	Primary OH (1ph) - install
	Riser - install
	Secondary Service (OH) - existing
	Secondary Service (OH) - install
	Service Pole - non-critical
	Service Pole - critical
	Utility Line - Int. group
	Utility Line - Int. group