


THIS IS A TWO-SIDED DOCUMENT

 <p>NEW YORK STATE OF OPPORTUNITY.</p> <p>Adirondack Park Agency</p> <p>PO Box 99 · 1133 NYS Route 86 Ray Brook, NY 12977 Tel: (518) 891-4050 www.apa.ny.gov</p>	<p>APA General Permit/Order 2019G-1</p>	<p>Permit: 2023-0105</p>
	<p>Certification for the Replacement of Certain Utility Poles</p>	

This certification under General Permit 2019G-1 is granted to National Grid, authorizing the replacement of utility poles as described herein in the Town of Moriah, Essex County.

All terms and conditions of this certification shall apply to the applicant and any individual, contractor, municipality, or other entity undertaking the authorized work on the project site.

This certification does not grant any right to trespass upon the lands or interfere with the riparian rights of others, nor does it authorize the impairment of any easement, right, title, or interest in real or personal property.

Nothing contained in this certification shall be construed to satisfy any legal obligations of the applicant to comply with all applicable laws and regulations or to obtain any governmental approval or permit from any entity other than the Agency, whether federal, state, regional, or local.

PROJECT DESCRIPTION AS PROPOSED

The project as conditionally approved herein involves the replacement of an existing utility pole measuring 29.5 feet in height above ground level with a new pole measuring 38.5 feet in height above ground level within the existing utility right-of-way. The pole is located within wetlands.

The project is shown on the following plans:

- A plan sheet titled “National Grid USA 41-21-30440594 6-12”, prepared by Anne Murray, National Grid, and dated February 11, 2022 (Site Plan); and
- A two-page report and map titled “Work Plan Narrative”, prepared by Patrick Blehar – National Grid, received by the Agency on July 14, 2023 (Work Plan Narrative).

A reduced-scale copy of the Site Plan and Page 2 of the Work Plan Narrative for the project is attached to this certificate for easy reference.

CONDITIONS

1. The height and location of the replacement utility poles and any associated vegetative cutting and maintenance shall comply with all applicable utility laws, regulations, safety requirements, and company specifications.

2. For projects involving wetlands:
 - a. Whenever practicable, access through wetlands shall occur on frozen ground and with the use of wide-tracked vehicles.
 - b. All activities shall occur in compliance with the "Best Management Practice for Preventing the Transportation of Invasive Plant Species," published by Environmental Energy Alliance of New York, 4/26/2012.
 - c. No temporary access structure, including bog mats and work pads, shall be located within a wetland for more than 30 days.
 - d. Existing poles to be replaced shall be removed completely from the wetland, including the portion of the pole that was below grade.
 - e. If any hole left after removal of a pole or created for a replacement pole is to be backfilled with gravel or other ballast, the top six inches shall be covered with organic soil and the final elevation shall be the same as the surrounding wetland surface.
 - f. The total area of wetland disturbance shall be limited to that necessary for replacement of the utility poles.
3. When brought from off-site, all vehicles, construction equipment, and hand excavation tools to be used on the project site shall be clean and free of soil, mud, or other similar material. If washed on the project site, equipment shall be washed in one location to prevent the distribution of propagules among different wash sites. All vehicles, construction equipment, and hand excavation tools used in areas that may contain existing invasive species shall be thoroughly cleaned prior to moving to other areas.
4. The Agency may conduct on-site investigations, examinations, and evaluations as it deems necessary to ensure compliance with the terms and conditions of this certification.


CERTIFICATION issued this 25th day
of July, 2023.

ADIRONDACK PARK AGENCY


BY: 
David J. Plante, AICP CEP
Deputy Director, Regulatory Programs

STATE OF NEW YORK
COUNTY OF ESSEX

On the 25th day of July in the year 2023, before me, the undersigned, a Notary Public in and for said State, personally appeared David J. Plante, personally known to me or proved to me on the basis of satisfactory evidence to be the individual whose name is subscribed to the within instrument and acknowledged to me that they executed the same in their capacity, and that by their signature on the instrument, the individual, or the person upon behalf of which the individual acted, executed the instrument.


Notary Public

Stephanie L. Petith
Notary Public, State of New York
Reg. No 01PE6279890
Qualified in Franklin County
Commission Expires April 15, 2025

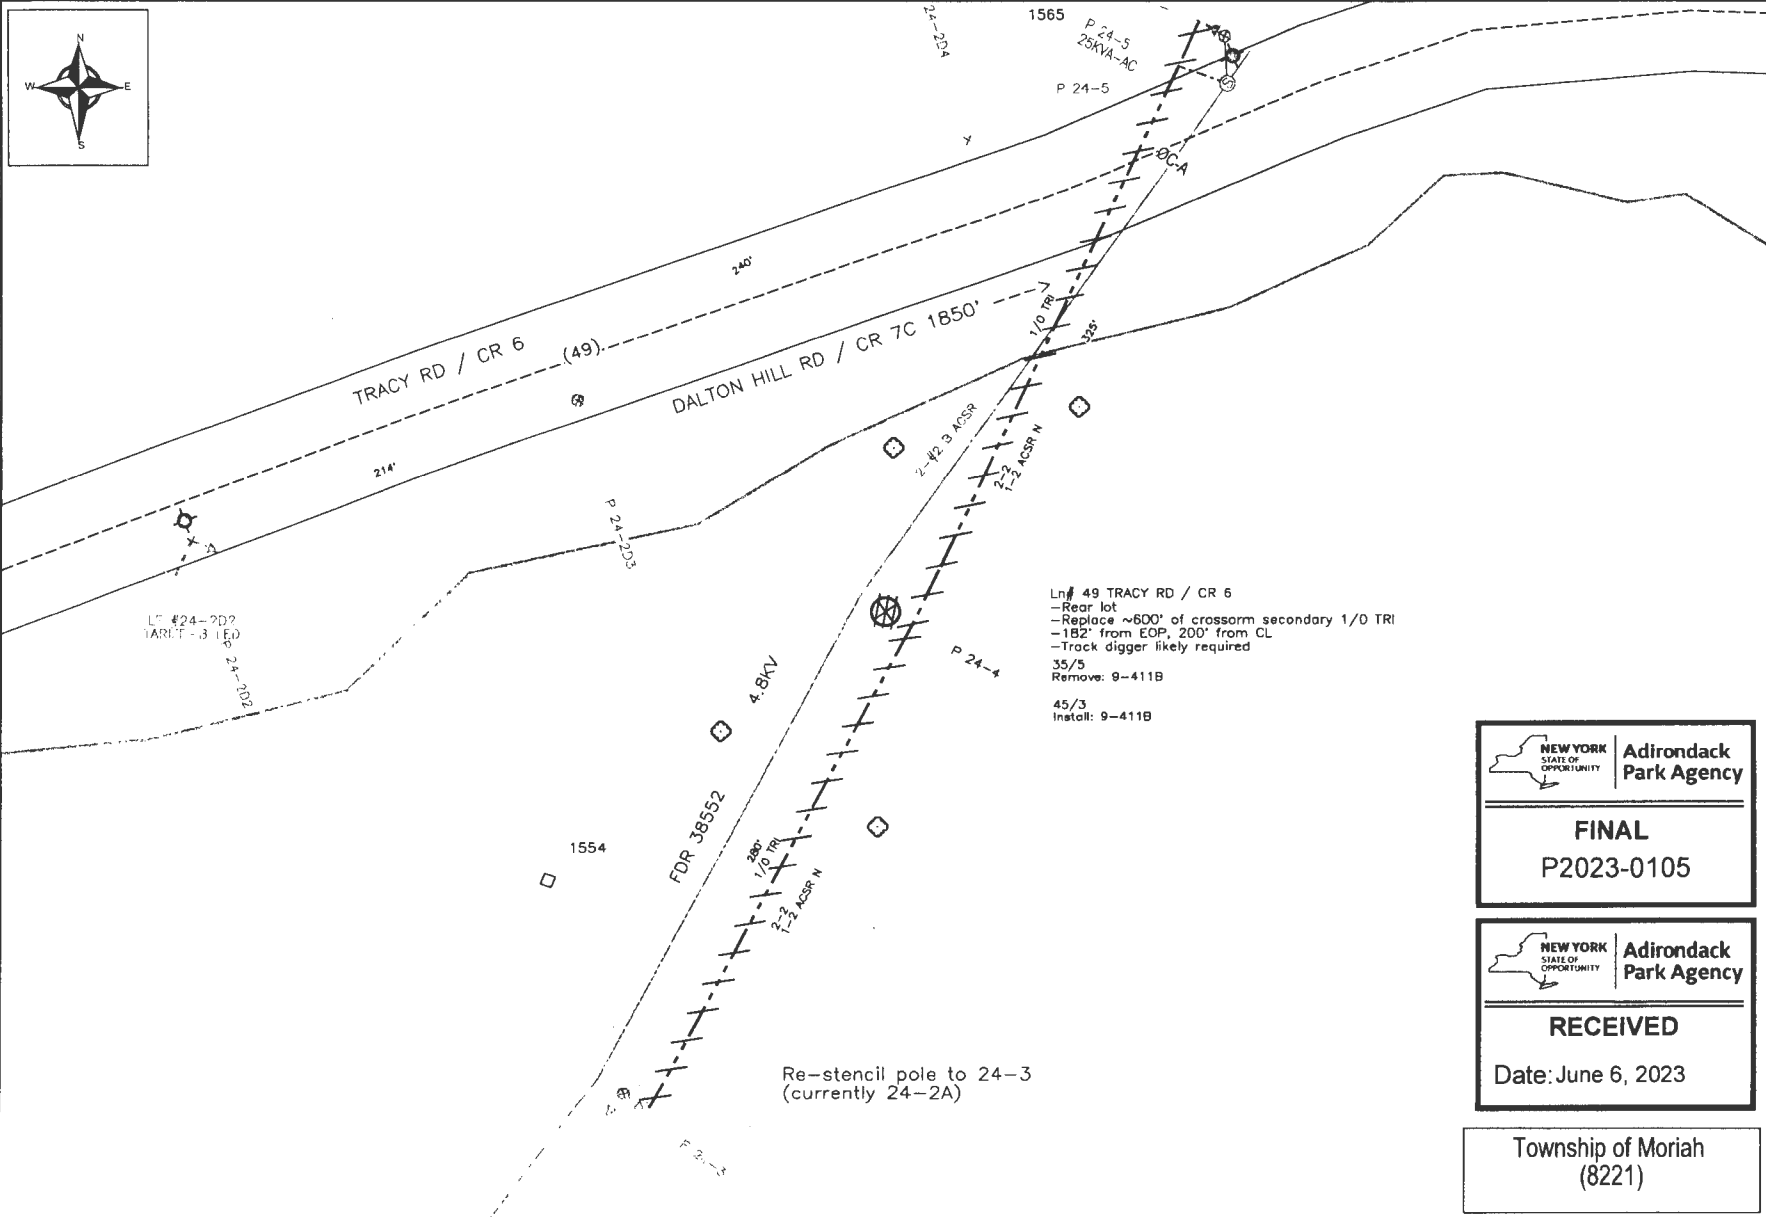

Ln# 49 TRACY RD / CR 6
 -Rear lot
 -Replace ~600' of crossarm secondary 1/0 TRI
 -182' from EOP, 200' from CL
 -Track digger likely required
 35/5
 Remove: 9-411B
 45/3
 Install: 9-411B

Re-stencil pole to 24-3
 (currently 24-2A)

NEW YORK STATE OF OPPORTUNITY
Adirondack Park Agency

FINAL
 P2023-0105

NEW YORK STATE OF OPPORTUNITY
Adirondack Park Agency

RECEIVED
 Date: June 6, 2023

Township of Moriah
 (8221)

NATIONAL GRID USA 41-21-30440594 6-12

120 FT
 60
 0
 MAJOR SCALE
 MINOR SCALE

WORK REQUEST: 41-21-30440594	ED/MC: 8221
STUDY ORDER: 30440594	PROJECT NO: 38552
DESIGNER: Murray, Anne	PHONE NUMBER: (509)-605-1684
JOB TITLE: 38552 P21 NTC I&M - Level 3	SHEET 6 OF 50
DATE: 02/11/2022	DATE: 02/11/2022
DESCRIPTION: FY 22 NTC I&M Level 3, 60 locations Township of Moriah, NY (8221) County of Essex, FDR 38552	TAP ID: SUPPLY SIDE



Structure 24-4 (depicted by the red circle) will be accessed via the driveway at 1554 Tracy Road and on the utility right of way (black line), as indicated by the orange arrows. The area highlighted by the yellow rectangle indicates potential area for timber mat placement and/or minor low grow brush trimming.