

THIS IS A TWO-SIDED DOCUMENT



**Adirondack
Park Agency**

PO Box 99 · 1133 NYS Route 86
Ray Brook, NY 12977
Tel: (518) 891-4050
www.apa.ny.gov

**APA General
Permit/Order
2019G-1**

Permit #: 2026-0197

**Certification for the Replacement
of Certain Utility Poles**

This certification under General Permit 2019G-1 is granted to National Grid, authorizing the replacement of utility poles as described herein in the Town of Harrietstown, Franklin County.

All terms and conditions of this certification shall apply to the applicant and any individual, contractor, municipality, or other entity undertaking the authorized work on the project site.

This certification does not grant any right to trespass upon the lands or interfere with the riparian rights of others, nor does it authorize the impairment of any easement, right, title, or interest in real or personal property.

Nothing contained in this certification shall be construed to satisfy any legal obligations of the applicant to comply with all applicable laws and regulations or to obtain any governmental approval or permit from any entity other than the Agency, whether federal, state, regional, or local.

PROJECT DESCRIPTION AS PROPOSED

The project as conditionally approved herein involves replacement of an existing utility pole measuring 38.5 feet above grade with an improved utility pole measuring 43 feet above grade, and the installation of one new utility pole measuring 38.5 feet above grade, along the existing utility distribution line.

The project is shown on a two-page plan titled "WR 31151626" prepared by National Grid and received by the Agency on September 23, 2026 (Project Plan).

A reduced-scale copy of the Project Plan for the project is attached to this certificate for easy reference. The original, full-scale maps and plans described in this paragraph are the official plans for the project, with copies available upon request from Adirondack Park Agency headquarters in Ray Brook, New York.

CONDITIONS

1. The height and location of the replacement utility poles and any associated vegetative cutting and maintenance shall comply with all applicable utility laws, regulations, safety requirements, and company specifications.
2. For projects involving wetlands:
 - a. Whenever practicable, access through wetlands shall occur on frozen ground and with the use of wide-tracked vehicles.


- b. All activities shall occur in compliance with the "Best Management Practice for Preventing the Transportation of Invasive Plant Species," published by Environmental Energy Alliance of New York, 4/26/2012.
 - c. No temporary access structure, including bog mats and work pads, shall be located within a wetland for more than 30 days.
 - d. Existing poles to be replaced shall be removed completely from the wetland, including the portion of the pole that was below grade.
 - e. If any hole left after removal of a pole or created for a replacement pole is to be backfilled with gravel or other ballast, the top 6 inches shall be covered with organic soil and the final elevation shall be the same as the surrounding wetland surface.
 - f. The total area of wetland disturbance shall be limited to that necessary for replacement of the utility poles.
3. When brought from off-site, all vehicles, construction equipment, and hand excavation tools to be used on the project site shall be clean and free of soil, mud, or other similar material. If washed on the project site, equipment shall be washed in one location to prevent the distribution of propagules among different wash sites. All vehicles, construction equipment, and hand excavation tools used in areas that may contain existing invasive species shall be thoroughly cleaned prior to moving to other areas.
4. The Agency may conduct on-site investigations, examinations, and evaluations as it deems necessary to ensure compliance with the terms and conditions of this certification.

Dated: September 24th, 2026

Ray Brook, New York


ADIRONDACK PARK AGENCY

By:


John M. Burth
Deputy Director, Regulatory Programs

STATE OF NEW YORK
COUNTY OF ESSEX

On the 24th day of September in the year 2026, before me, the undersigned, a Notary Public in and for said State personally appeared John M. Burth, personally known to me or proved to me on the basis of satisfactory evidence to be the individual whose name is subscribed to the within instrument and acknowledged to me that they executed the same in their capacity, and that by their signature on the instrument, the individual, or the person upon behalf of which the individual acted, executed the instrument.


Notary Public

STEPHANIE PETITH
Notary Public, State of New York
Reg. No. 01PE6279890
Qualified in Essex County
Commission Expires April 15, 2029

National Grid W/R 31151626

This project requires replacing existing pole 9 and installing a new pole 9.5 on County Route 45 in the Town of Hamletstown, Franklin County NY.

Pole 9 - Existing Height: 38.5' above grade
Pole 9 - Proposed Height: 43' above grade.
(red circle)

Pole 9.5 - Proposed height 38.5' above grade.
(blue circle)

These poles will be accessed and installed roadside.



NEW YORK
STATE OF
ADIRONDACK
Adirondack
Park Agency

RECEIVED

Date: September 23, 2026

NEW YORK
STATE OF
ADIRONDACK
Adirondack
Park Agency

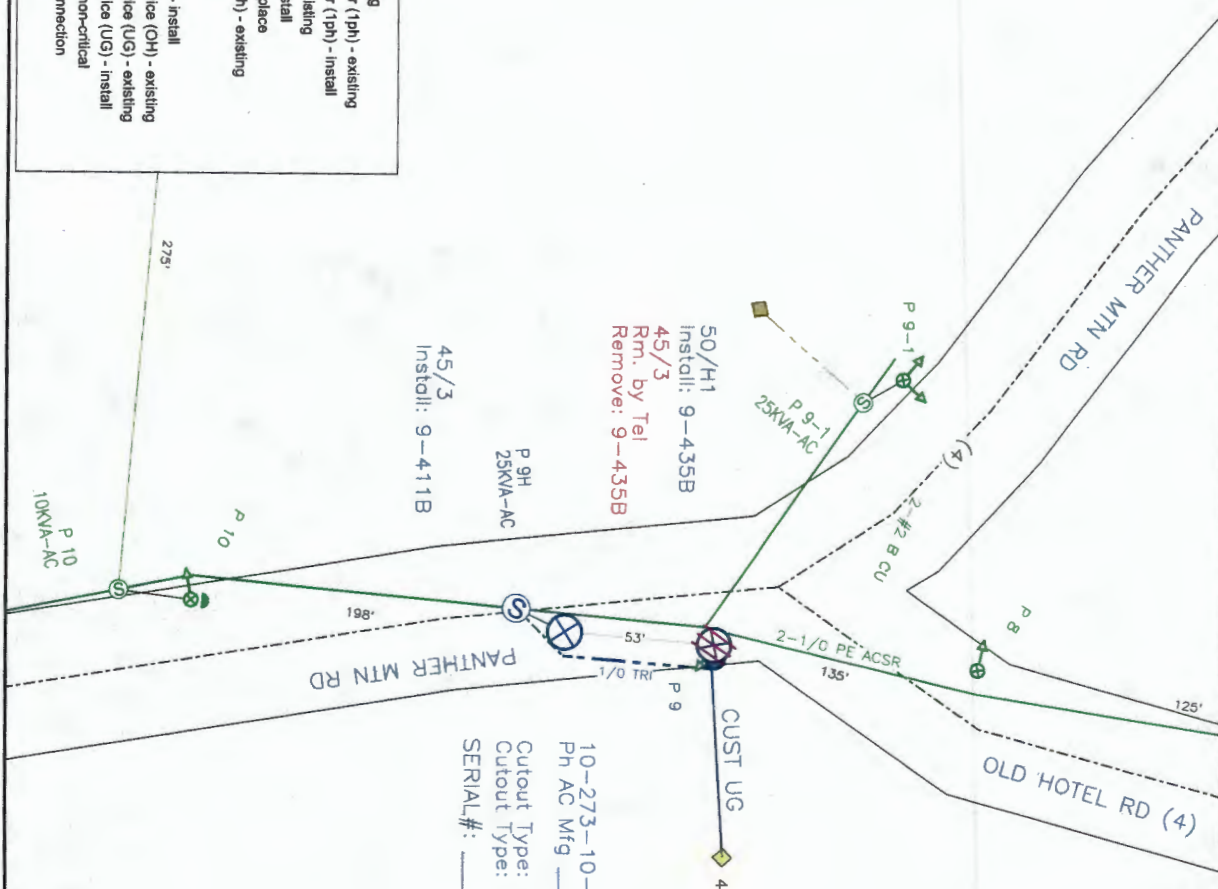
FINAL

P2026-0197



- Anchor - existing
- OH Transformer (1ph) - existing
- OH Transformer (1ph) - install
- Pole (Joint) - existing
- Pole (Joint) - install
- Pole (Joint) - replace
- Primary OH (1ph) - existing
- Riser - existing
- Riser - install
- Secondary OH - install
- Secondary Service (OH) - existing
- Secondary Service (UG) - existing
- Secondary Service (UG) - install
- Service Point - non-critical
- Transformer Connection

4.8KV
TD 6348
FDR 95661



10-273-10-00 25KVA
Ph AC Mfg _____ mo/yr _____
Circuit Type: Non-Porcelain
Circuit Type: Non-Porcelain
SERIAL#:

REPL P9 W/ 50/H1 - NEED CLEARANCE FROM COMMS/ARMS.

FLAGGING NEEDED
NEED APA PERMIT FOR 50FT POLE

MICHAEL MCDOWALL
4 OLD HOTEL RD, TUPPER LAKE, NY
GPS: 44.250160, -74.336184

ELECTRICIAN: GLADD ELECTRIC
PHONE: (518) 891-5136

NEW RESIDENTIAL SERVICE
1 MTR, 200A - 120/240V.

SS TAP ON CUST UG.
INST NEW 45/3 MIDSPAN P9H.

INST 25KVA XFMR ON P9H.

INST 53FT OF 1/0 TRI FROM P9H TO P9.

INST RISER ON P9.

METER ON PEDESTAL.



NATIONAL GRID USA

24-26-31151626

WORK REQUEST: 24-26-31151626	DESCRIPTION:	☐ BUILT AS DESIGNED	T.D./T.O. 6348
STORMS ORDER: 31151626	DATE: 08/18/2026	☐ AS BUILT CHANGES	FEEDER NO. 95681
DESIGNER: Miller, Courtney	SS TAP ON CUST UG.	PHONE NUMBER:	315-956-2245
JOB TITLE: 4 HOTEL RD	INST NEW 45/3 MIDSPAN P9H.	DATE:	SHEET 1 OF 2
FOREMAN SIG:	INST 25KVA XFMR ON P9H.	SUPV SIG:	
	INST 53FT OF 1/0 TRI FROM P9H TO P9.		
	INST RISER ON P9.		
	METER ON PEDESTAL.		

0 50 100 FT

☐ MAINLINE MAP/VOLTAGE CONVERSIONS UPDATE REQUIRED